




SEAL REPORT

Envelope sealing performed for:

Date: 12/21/2025
Floor Area: 3724.00 ft²
Structure Volume: 34170.00 ft³

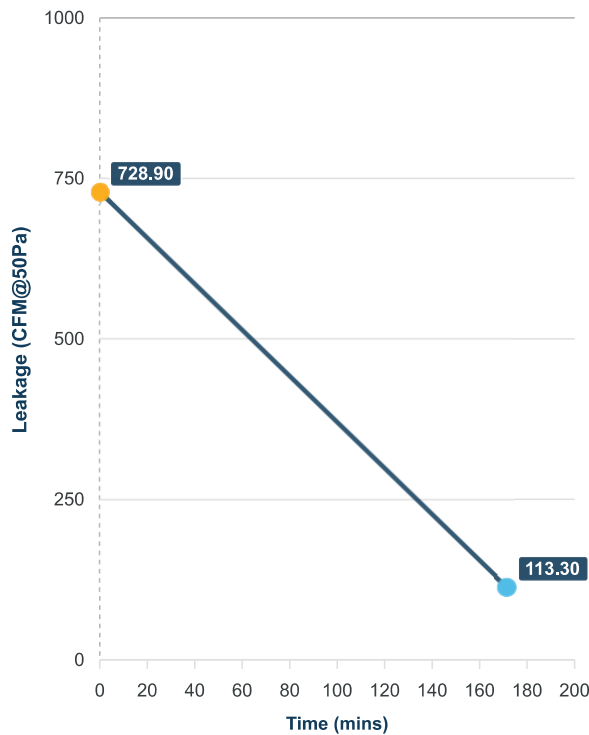

ACH@50Pa

1.28
ACH@50Pa

0.20
ACH@50Pa

Leakage equivalent to

87.8 Sq.In

13.6 Sq.In

● Before ● After

84.5%
Reduction in
Envelope
Leakage

02:51
hh:mm
Seal Time

Note: Envelope leakage and air-change results are calculated at a STANDARD OPERATING PRESSURE of 50 Pa.

Envelope sealing performed by:

Brodie Smith
Kootenay Airseal Inc.
200 Blackforest Trail
Invermere, B.C. V0A 1K2
Phone: (250) 342 5673

Aeroseal Case ID: 8389
Hardware: AeroBarrier Connect



Scan for more details

Aeroseal
aeroseal.com
877-999-9999
info@aeroseal.com

